



# PJM Manual 13: Emergency Operations v90 Revision Summary

Donnie Bielak  
Sr. Manager, Dispatch  
August 10, 2023  
Operating Committee

NERC issued a Level 3 Cold Weather Preparations for Extreme Events III and distributed to:

- Balancing Authorities
- Generator Owners
- Transmission Operators

The alert includes eight Essential Actions and a series of questions.

- Responses due October 6, 2023
- NERC Alert public posting [link](#)
- [Webinar Presentation](#)
- [FAQ](#)


Essential Action #5: Per [EOP-011-3](#), each TOP should update their Operating Plan(s) to include:

- Provisions to minimize the overlap of circuits that are designated for manual load shed and circuits that serve designated critical loads;
- Provisions to minimize the overlap of circuits that are designated for manual load shed and circuits that are utilized for underfrequency load shed (UFLS) or undervoltage load shed (UVLS);
- Provisions for limiting the utilization of UFLS or UVLS circuits for manual load shed to situations where warranted by system conditions; and
- Provisions for manual load shedding capable of being implemented in a timeframe adequate for mitigating the emergency.

- Section 2.3.2 “Real-Time Emergency Procedures (Warnings and Actions)”
  - Added the following to Step 10:
    - The load shed plan must consider/recognize **provisions as documented** in the Note below
    - **Member Load shed plans must recognize:**
      - Provisions to minimize the overlap of circuits that are designated for manual load shed and circuits that serve designated critical loads;
      - Provisions to minimize the overlap of circuits that are designated for manual Load shed and circuits that are utilized for underfrequency load shed (UFLS) or undervoltage load shed (UVLS); and;
      - Provisions for limiting the utilization of UFLS or UVLS circuits for manual Load shed to situations where warranted by system conditions.<sup>1</sup>
      - Where footnote “1” is: Underfrequency load shedding circuits should only be used for manual load shed as a last resort and should start with the final stage (lowest frequency).

- Section 5.2 “Transmission Security Emergency Procedures”
  - Added the following to Step 10:
    - The load shed plan must consider/recognize:
      - Provisions to minimize the overlap of circuits that are designated for manual load shed and circuits that serve designated critical loads;
      - Provisions to minimize the overlap of circuits that are designated for manual Load shed and circuits that are utilized for underfrequency load shed (UFLS) or undervoltage load shed (UVLS); and;
      - Provisions for limiting the utilization of UFLS or UVLS circuits for manual Load shed to situations where warranted by system conditions.<sup>2</sup>
      - Where footnote “2” is: Underfrequency load shedding circuits should only be used for manual load shed as a last resort and should start with the final stage (lowest frequency).

- Attachment F “PJM Manual Load Dump Capability”
  - Added the following to existing note:
    - All Member Load shed plans are to minimize the overlap of circuits that are designated for manual Load shed and circuits that are utilized for UFLS.

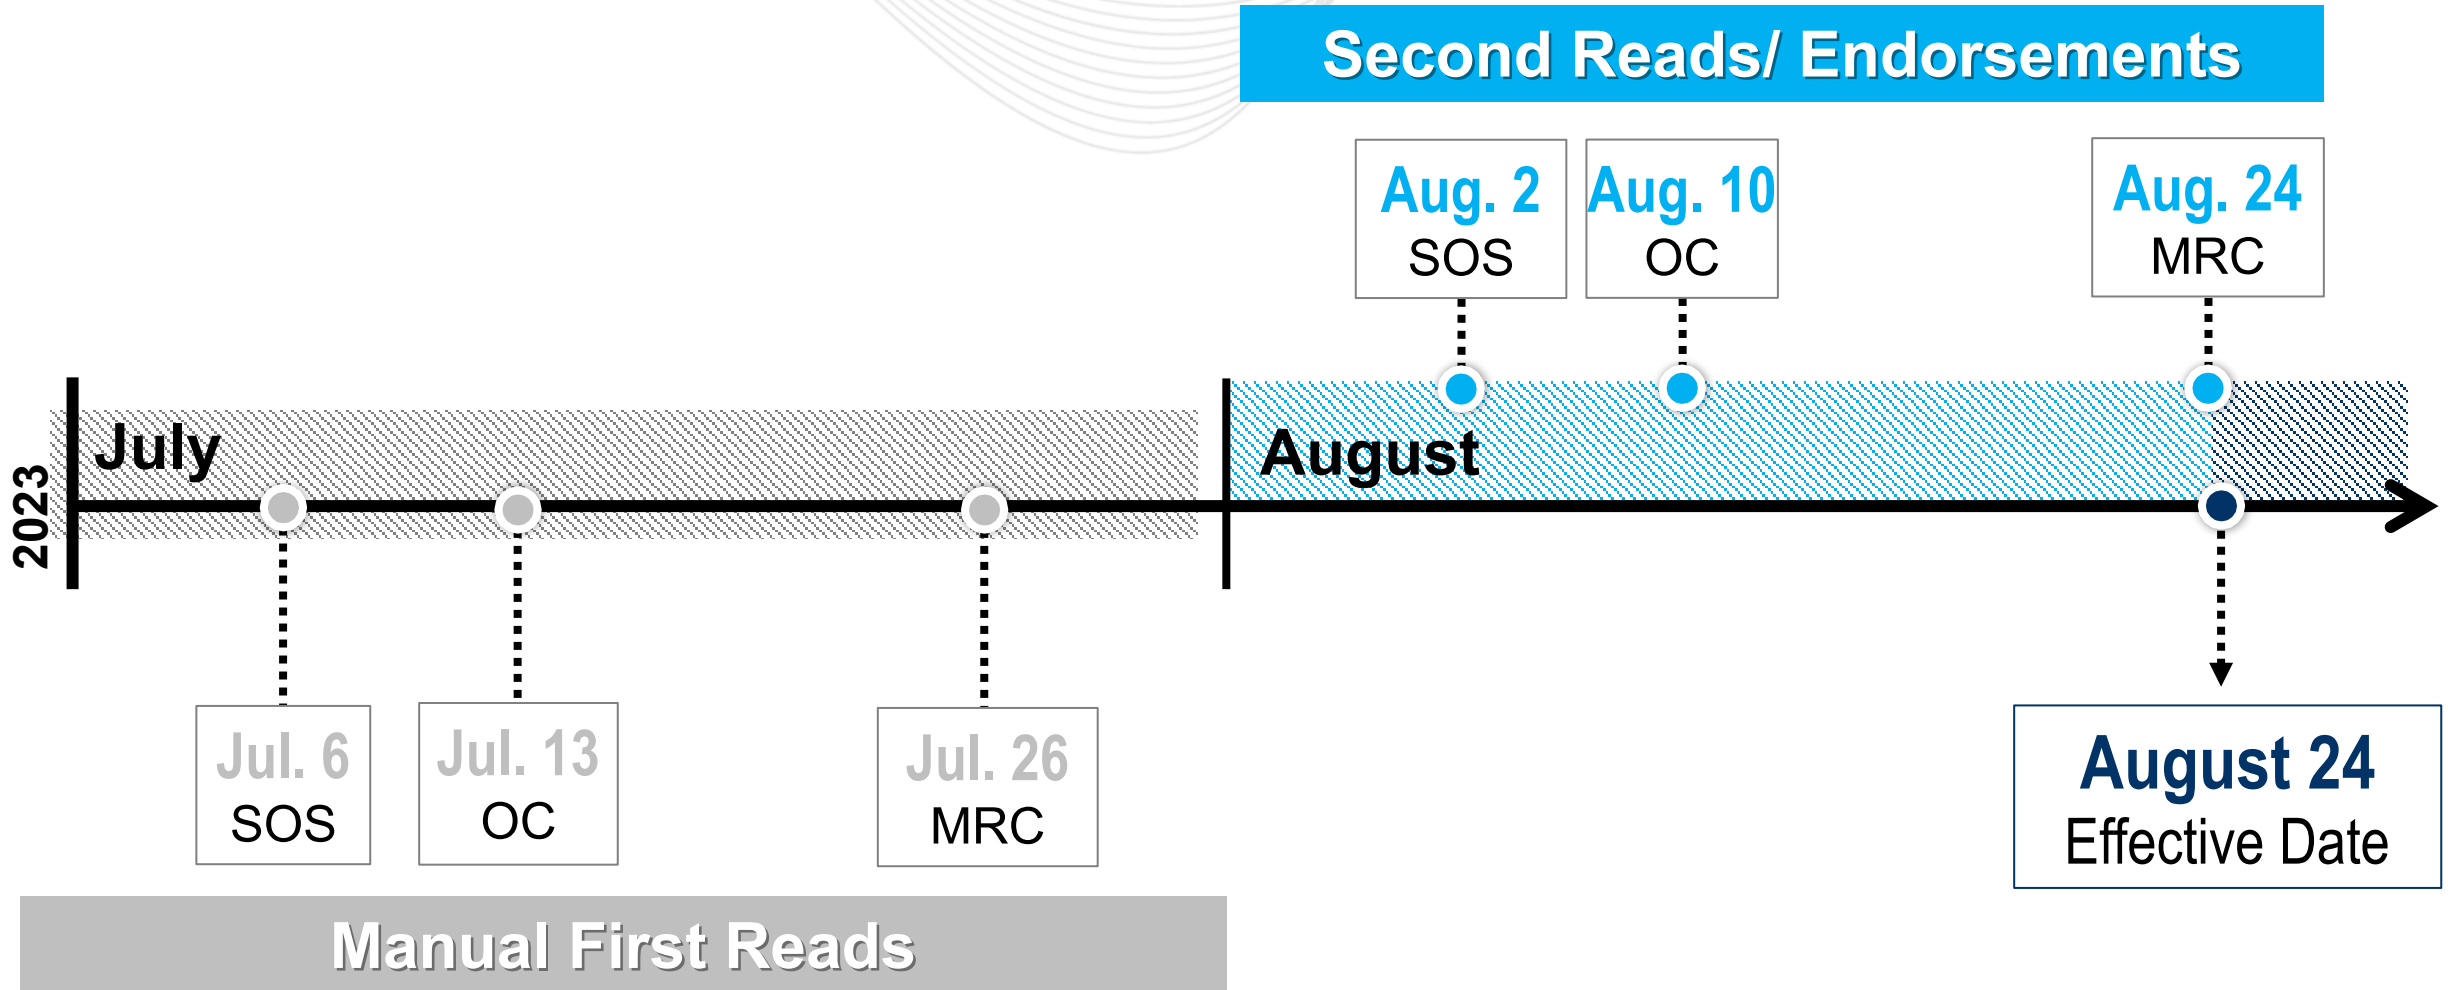

Presenter/SME:  
Frank Hartman,  
[Frank.Hartman@pjm.com](mailto:Frank.Hartman@pjm.com)

Facilitator:  
Matthew Wharton,  
[Matthew.Wharton@pjm.com](mailto:Matthew.Wharton@pjm.com)

## **M-13 Version 90 Revisions**



### Member Hotline

(610) 666 – 8980

(866) 400 – 8980

[custsvc@pjm.com](mailto:custsvc@pjm.com)



**PROTECT THE  
POWER GRID  
THINK BEFORE  
YOU CLICK!**



Be alert to  
malicious  
phishing emails.

**Report suspicious email activity to PJM.**  
(610) 666-2244 / [it\\_ops\\_ctr\\_shift@pjm.com](mailto:it_ops_ctr_shift@pjm.com)

