



TEAC - Western Committee ComEd Supplemental Projects

January, 9 2024

Needs

Stakeholders must submit any comments within 10 days of this meeting in order to provide time necessary to consider these comments prior to the next phase of the M-3 process

Need Number: ComEd-2024-001

Process Stage: Need Meeting 1/9/2024

Project Driver:


Customer Service

Specific Assumption Reference:

- New transmission customer interconnections or modification to an existing customer

Problem Statement:

- A new customer is looking for transmission service in the Dekalb area. Initial loading is expected to be 53 MW in June 2027, 160 MW in 2028, with an ultimate load of 210 MW.
- ComEd Distribution Capacity Planning requested additional capacity in the Dekalb area to accommodate load growth of 15 MW. Existing distribution facilities do not have enough capacity to accommodate this load growth.

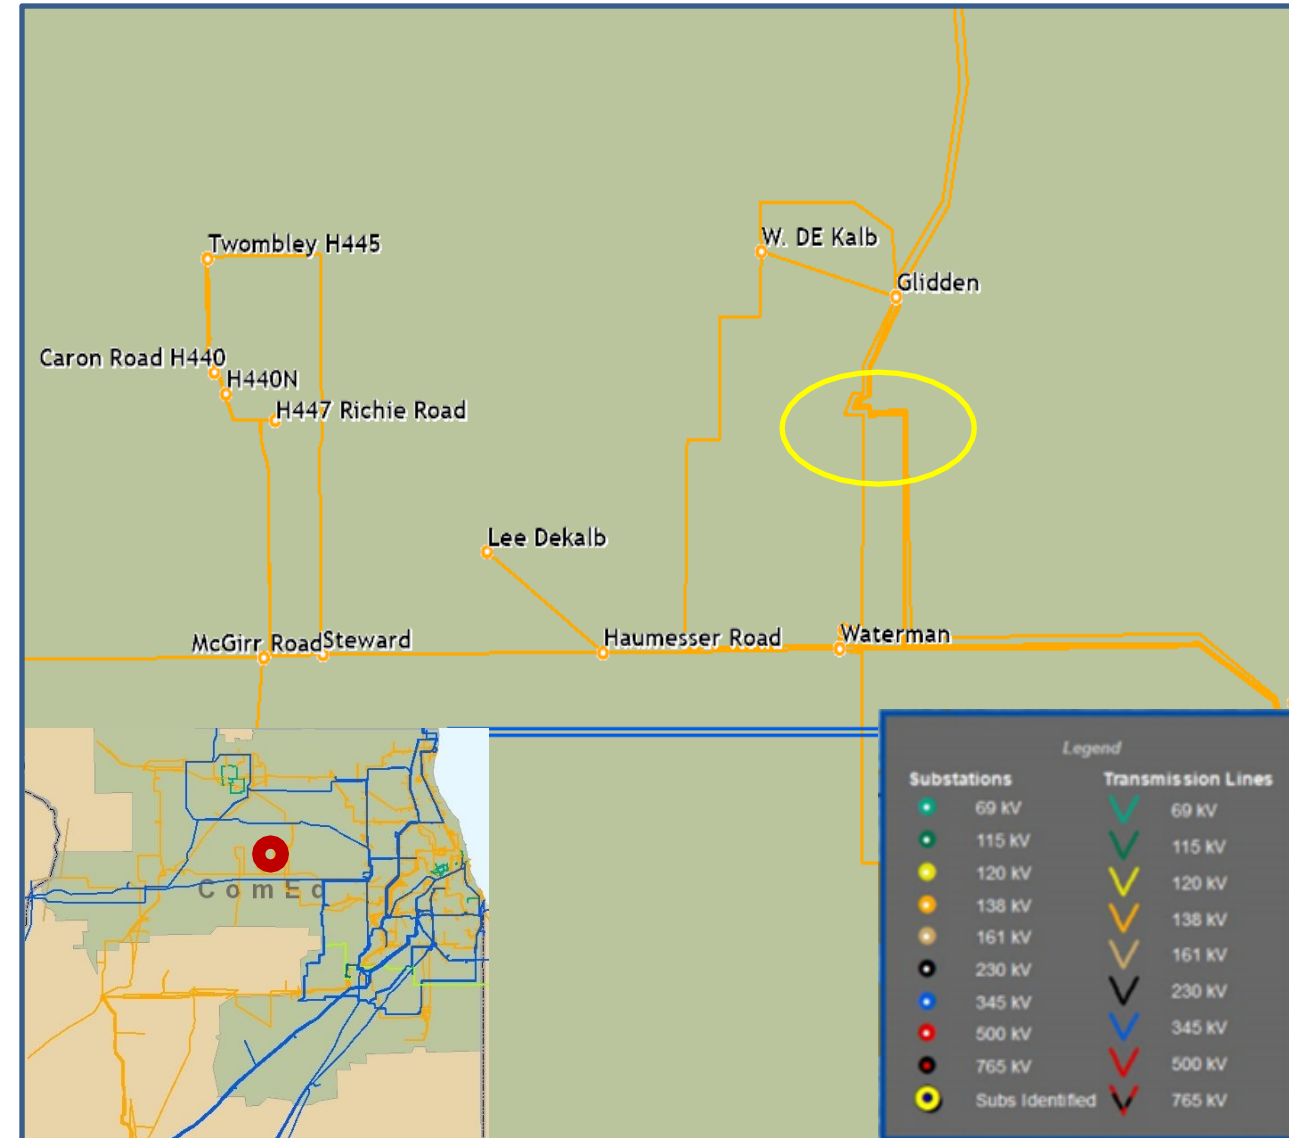

Appendix

High Level M-3 Meeting Schedule

Assumptions	Activity	Timing
	Posting of TO Assumptions Meeting information	20 days before Assumptions Meeting
	Stakeholder comments	10 days after Assumptions Meeting
Needs	Activity	Timing
	TOs and Stakeholders Post Needs Meeting slides	10 days before Needs Meeting
	Stakeholder comments	10 days after Needs Meeting
Solutions	Activity	Timing
	TOs and Stakeholders Post Solutions Meeting slides	10 days before Solutions Meeting
	Stakeholder comments	10 days after Solutions Meeting
Submission of Supplemental Projects & Local Plan	Activity	Timing
	Do No Harm (DNH) analysis for selected solution	Prior to posting selected solution
	Post selected solution(s)	Following completion of DNH analysis
	Stakeholder comments	10 days prior to Local Plan Submission for integration into RTEP
	Local Plan submitted to PJM for integration into RTEP	Following review and consideration of comments received after posting of selected solutions

Revision History

12/27/2023 – V1 – Original version posted to pjm.com