

Queue Interconnection Studies of Projects Potentially Affecting Neighboring Systems

IPSAC WebEx

Phil Chorazy

Summary

- Projects in the respective ISO/RTO interconnection queues may have potential interregional effects on neighboring systems
 - This requires coordination of studies across ISO/RTO borders
- The Joint ISO/RTO Planning Committee continues to
 - Coordinate system data bases and models
 - Identify and evaluate the performance of projects affecting interregional system performance
- The ISO/RTO interconnection queues can be found at:

<http://www.iso-ne.com/system-planning/transmission-planning/interconnection-request-queue>

[http://www.nyiso.com/public/webdocs/markets_operations/services/planning/Documents and Resources/Interconnection Studies/NYISO Interconnection Queue/NYISO%20Interconnection%20Queue.xls](http://www.nyiso.com/public/webdocs/markets_operations/services/planning/Documents_and_Resources/Interconnection_Studies/NYISO_Interconnection_Queue/NYISO%20Interconnection%20Queue.xls)

<https://www.pjm.com/planning/services-requests/interconnection-queues.aspx>

- Several projects will now be discussed with the IPSAC
 - Slides show the effective date of November 1, 2018 for every ISO/RTO Queue
 - Changes from the May 18, 2018 IPSAC meeting are shown in **red**

NYISO TRANSMISSION AND GENERATION PROJECTS WITH POTENTIAL INTERREGIONAL IMPACTS

Phil Chorazy - NYISO

NYISO Interconnection Queue Projects with Potential ISONE/PJM Impact

Transmission Project	Queue Number(s)	Zone(s)	Regions Affected	Proposed I/S Date
West Point Partners HVDC	358	F, H	ISO-NE / PJM	2021/01
Poseidon HVDC	363	K	ISO-NE / PJM	2020/07
Grand Isle Intertie Development	386	D	ISO-NE	2023
NAT Segment B Enhanced	414*	F, G	ISO-NE / PJM	2019
Alps HVDC	448	F	ISO-NE	2019/06
Champlain Hudson (CH) Interconnection	458	J	ISO-NE / PJM	2021/Q1
Hudson Transmission Partners NY to PJM	465	J	PJM	2021/01
Empire State Connector HVDC	506	C, J	ISO-NE / PJM	2021/10
PPL Electric Utilities Compass	518	G	PJM	2023/12
NextEra Empire State Line	530	A	PJM	2020/05
NextEra Segment A	537*	E, F	ISO-NE / PJM	2018/11
NextEra Segment B	538*	F, G	ISO-NE / PJM	2024/06
NextEra Segment B Alt	539*	F, G	ISO-NE / PJM	2024/06
AVANGRID Connect NY Edic – PV	540	E, G	ISO-NE / PJM	2020/12
AVANGRID Connect NY Edic – Ramapo	541	E, G	ISO-NE / PJM	2020/12
National Grid Segment A Edic-New Scotland	542*	E, F	ISO-NE / PJM	2021/12
National Grid Segment B Knickerbocker-PV	543*	F, G	ISO-NE / PJM	2021/12
NextEra Empire State Line Alt	545A	A	PJM	2021/04

Note: Projects listed with an * after their queue number are part of the AC Transmission Public Policy Transmission Need evaluation. Only one set of projects will be selected for development.

NYISO Interconnection Queue Projects with Potential ISONE/PJM Impact (continued)

Transmission Project	Queue Number(s)	Zone(s)	Regions Affected	Proposed I/S Date
NAT Segment A Base	555*	E, F	ISO-NE / PJM	2020/01
NAT Segment A Double Circuit	556*	E, F	ISO-NE / PJM	2020/06
NAT Segment A Enhanced	557*	E, F	ISO-NE / PJM	2020/01
NAT Segment A 765	558*	E, F	ISO-NE / PJM	2020/01
NAT Segment B Base	559*	E, F	ISO-NE / PJM	2019/09
ITC Segment A	608*	E, F	ISO-NE / PJM	2020/04
ITC Segment B	609*	E, F	ISO-NE / PJM	2021/04
West Point II HVDC	615	F, H	ISO-NE / PJM	2022/01
Champlain Hudson NS Power Express HVDC	631	J	PJM	2021/12
GridAmerica Holdings Alps - Berkshire	632	F	ISO-NE	2021/09
AVANGRID Oakdale - Lafayette	641	C	PJM	N/A
AVANGRID Multiple Areas	643	C, E	PJM	N/A
ITC Lake Erie Connector	684	A	PJM	2024/10

Note: Projects listed with an * after their queue number are part of the AC Transmission Public Policy Transmission Need evaluation. Only one set of projects will be selected for development.

NYISO Interconnection Queue Projects with Potential ISONE/PJM Impact (Cont.)

Generation Project	Queue Number(s)	Zone(s)	Regions Affected	Proposed I/S Date	MW
Cassadaga Wind	387	A	PJM	2020/05	126
Caithness Long Island II	401	K	ISO-NE / PJM	2022/04	599
EDP Renewables North America Arkwright Summit	421	A	PJM	2017/10	78.4
Cricket Valley Energy Center	444	G	ISO-NE	2017/12	1020
Atlantic Wind Bone Run	466	A	PJM	2021/11	132
Renovo Energy Center	496	C	PJM	2019/09	480
Tioga County Power	498	C	PJM	2020/06	550
RES America Developments Ball Hill Wind	505	A	PJM	2019/09	100
East Coast Power Linden Cogen Uprate	516	J	PJM	2020/05	234.4
Dunkirk Unit 2	523	A	PJM	2020/01	75
Dunkirk Unit 3 & 4	524	A	PJM	2020/01	370
North Park Energy SW Energy	595	A	PJM	2019/10	110.1
Invenergy Alle Cat II Wind	596	A	PJM	2021/10	381.1
North Bergen Liberty Generating Alternative	668	J	PJM	2021/05	1171
Anbaric NYC Offshore Wind	679	J	PJM	2025/07	1200
Anbaric LI Offshore Wind	680	K	ISO-NE / PJM	2025/07	700
Renovo Energy Center Uprate	693	C	PJM	2020/10	515
Anbaric NYC Offshore AC	703	J	PJM	2025/07	800
Equinor Wind US Empire Wind	737	J	PJM	2023/06	816
Equinor Wind US Empire Wind II	738	K	ISO-NE / PJM	2023/06	816
Anbaric NY Ocean Grid - Canal	754	K	ISO-NE / PJM	2025/07	800
Anbaric NY Ocean Grid - Shoreham	755	K	ISO-NE / PJM	2025/07	800

ISO NEW ENGLAND TRANSMISSION AND GENERATION PROJECTS WITH POTENTIAL INTERREGIONAL IMPACTS

Al McBride – ISO-NE



ISO New England Interconnection Requests that had, are having, or will need Interregional Coordination

Active Projects

QP	Type	Requested	Alternative Name	Net MW	ST	OpDate	Interconnection Point	SIS
486	G	12/19/2014	Wind	250	ME	12/01/2021	Orrington—Pt. Lapreau 345 kV, Alt: BHE Deblois 115 kV substation	No
499	ETU	2/16/2015	300 kV HVDC/AC Tie - Import Only	1090	NH	4/30/2019	HQ Des Cantons substation to PSNH Deerfield substation	Yes
500	ETU	2/16/2015	Keene Road ETU		ME	12/01/2018	Emera Keene Road substation	No
501	ETU	2/16/2015	HVDC Tie - Import only	1000	VT	5/31/2022	HQ 735 kV substation to VELCO 345 kV Coolidge substation	Yes
506	ETU	2/16/2015	Internal HVDC - North to South flow	1000	MA	6/30/2019	NMISA to NSTAR 345 kV K Street substation	Yes
508	ETU	2/16/2015	HVDC from NY to WMA - bidirectional	600	MA	8/30/2019	NY Alps substation to WMECO Berkshire substation	Yes
569	ETU	10/16/2015	HVDC from ME to MA (MA import only)	1200	MA	12/31/2021	Emera Orrington 345 kV substation to Eversource Jordan Rd	No
592	G	1/21/2016	Pumped Storage Upgrade	66	MA	6/2/2020	GRID 230 kV Bear Swamp substation	Yes
611	G	4/25/2016	Combustion Turbine	109	CT	6/1/2019	Eversource Energy 115 kV Middle River Sub Danbury, CT	No

QP is Queue Position; ETU is Elective Transmission Upgrade; G is Generator; SIS: Yes means report available, No means system impact study is not complete and no report is available

ISO New England Interconnection Requests that had, are having, or will need Interregional Coordination

Active Projects

QP	Type	Requested	Alternative Name	Net MW	ST	OpDate	Interconnection Point	SIS
627	ETU	12/27/16	HVDC Tie - Import only	1200	NH	12/31/2022	National Grid 230 kV Comerford Substation	No
639	ETU	4/19/2017	HVDC Tie	1000	ME	12/31/2020	CMP Larrabee Rd 345 kV Substation	No
640	ETU	4/21/2017	HVDC Tie - Import only	1200	MA	12/31/2022	Coleson Cove 345kV Substation, New Brunswick to 345kV lines from Pilgrim Substation	No
651	ETU	5/11/2017	AC Tie	600	MA	12/31/2021	NY Alps 345kV Substation and Eversource Berkshire 345 kV Substation	No
783	ETU	9/18/2018	HVDC Tie - Import only	400	VT	12/31/2023	NY Plattsburgh 230 kV Substation and VELCO New Haven 345 kV Substation	No


QP is Queue Position; ETU is Elective Transmission Upgrade; G is Generator; SIS: Yes means report available, No means system impact study is not complete and no report is available

PJM TRANSMISSION AND GENERATION PROJECTS WITH POTENTIAL INTERREGIONAL IMPACTS

Chuck Liebold - PJM



PJM Queue Units near PJM-NY Border That Are Jointly Coordinated with NYISO and ISO-NE

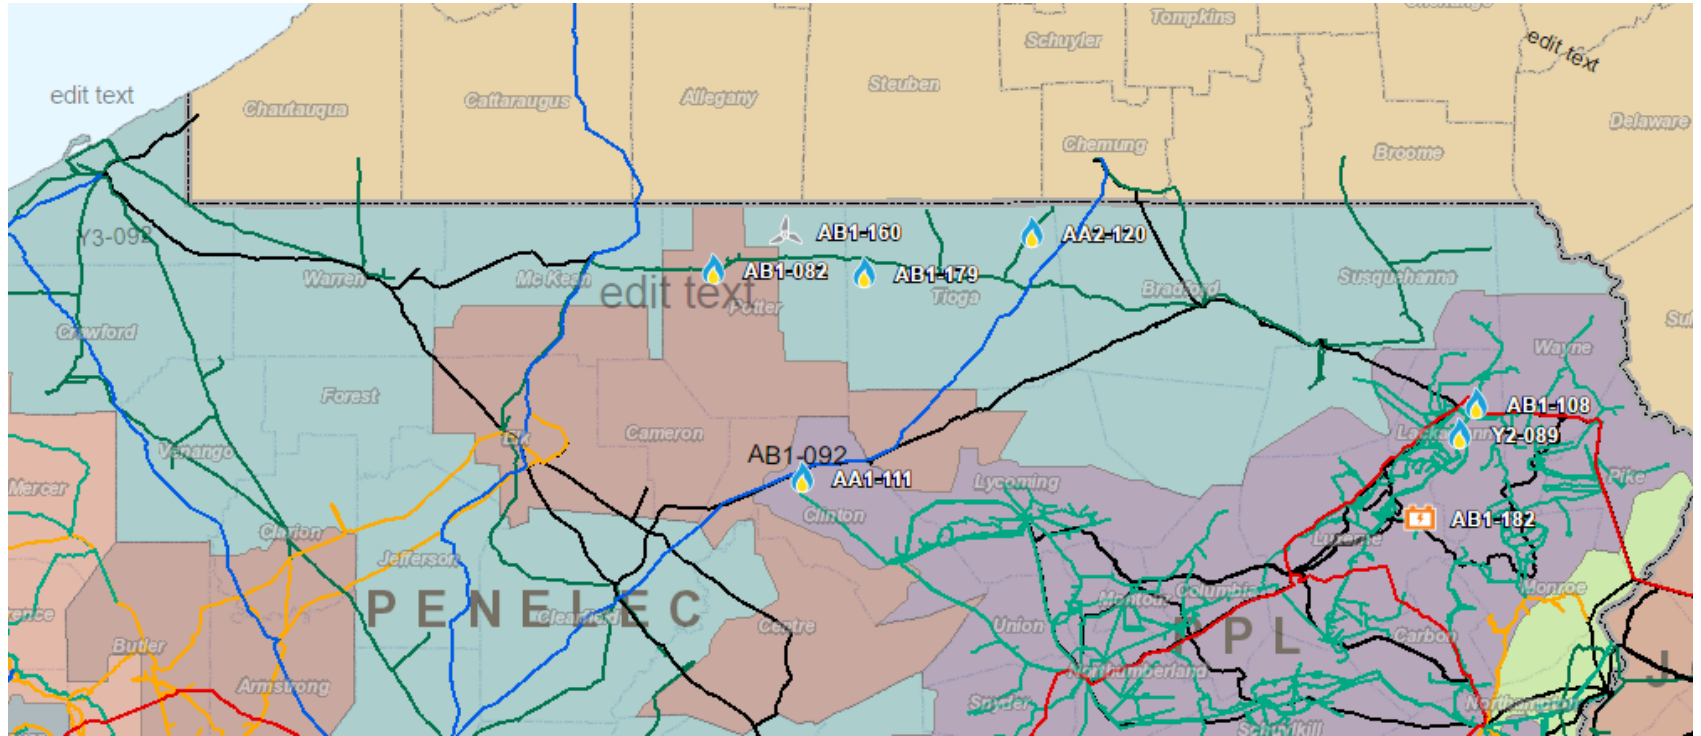

PJM Queue Projects jointly Coordinated with NYISO and ISO-NE

Queue ID	Project Description	Transmission Zones	Total Facility Capacity (MW)	Capacity Value (MW)	Energy Value (MW)	Project Status	Projected In Service Date
Y2-089	Increase to X4-048 (PJM Project) a combined cycle natural gas facility connected at the Lackawana 230 kV bus	PPL	1370	370	370	Under Construction	2019 Q1
Y3-092	Merchant transmission project (HVDC) connected at the Erie West 345 kV bus	PENELEC	1000 MW firm injection; 500 MW firm withdrawal; 500 MW non-firm withdrawal			Facilities Study in progress	2021 Q4
AA1-111	Natural gas generating facility along the Moshannon-East Towanda 230 kV line	PENELEC	463	463	463	Facilities Study in progress	2021 Q4
AA2-120	Natural gas generating facility that will interconnect with PENELEC system by either connecting at the Tower Hill 115 kV substation or connecting at the Ward 115 kV substation	PENELEC	250	250	250	Withdrawn	2020 Q2
AB1-082	Natural gas facility connected as a tap of the Potter-Coneville 46kV line in APS	APS	19.9	19.9	19.9	Suspended	2019 Q3
AB1-084	Natural gas facility connected to the Elk Mountain Tap 69kV substation	PPL	19.9	19.9	19.9	Withdrawn	2017 Q4
AB1-092	Uprate to the AA1-111 project connected as a tap of the Chapman-Lobo 230 kV line	PENELEC	504	17	41	Facilities Study in progress	2021 Q2
AB1-100	480 MW Network Long Term Firm request from the Renovo Energy Center in NYISO into PJM	N/A	480	N/A	N/A	Withdrawn	2020 Q2
AB1-108	Natural gas facility connected as a tap of the Lackawanna-Paup 230 kV line	PPL	485	485	485	System Impact Studies in progress	2019 Q2
AB1-160	Wind facility uprate to the Z1-069 project tapping the Gold-Sabinsville 115 kV line	PENELEC	90	3.8	20	Under Construction	2019 Q2
AB1-179	Natural gas facility connected at the Sabinsville 34.5 kV	PENELEC	19.9	19.9	19.9	Withdrawn	2017 Q4
AB1-182	Storage facility connected at the Bear Creek 69kV	PPL	20	0	20	Facilities Study in progress	2022 Q4

Latest Update on PJM Queue Projects near NYISO border (December 2018 IPSAC)

Queue ID	Project Description	Transmission Zones	Total Facility Capacity (MW)	Capacity Value (MW)	Energy Value (MW)	Project Status	Projected In Service Date
AC2-77	Sabinsville 34.5 kV	PENELEC	20	20	20	Facilities Study	05/31/18
AC2-092	Susquehanna-Lackawanna 500 kV	PPL	1105	65	55	Facilities Study	06/01/21
AD1-108	Grover 34 kV	PENELEC	21.4	1.5	1.5	In Service	07/16/18
AD1-109	Canton 34.5 kV	PENELEC	21	1.1	1.1	In Service	05/10/18
AD1-110	North Meshoppen 34.5 kV	PENELEC	21.4	1.5	1.5	In Service	06/22/18
AD1-142	Milan 34.5 kV	PENELEC	21	1.1	1.1	In Service	04/24/18
AD2-002	Franklin-Emerald 25 kV	APS	20	20	20	SIS	12/06/19
AD2-009	McConnellsburg 138kV	APS	70	48.1	70	SIS	06/30/19
AD2-028	McConnellsburg-Texas Eastern	APS	150	76.3	150	Withdrawn	06/30/19
AD2-035	Ontelaunee 230 kV	ME	630	14	38.9	SIS	12/01/19
AD2-050	Buxom 69 kV	PPL	200	200	200	Withdrawn	12/31/19
AD2-055	Moshannon-East Towanda 230 kV	PENELEC	548	35	44	SIS	10/01/2020

Questions

